


MINIMUM REQUIREMENTS FOR UNQUALIFIED WORKERS AND/OR EQUIPMENT OPERATING NEAR OVERHEAD POWER LINES

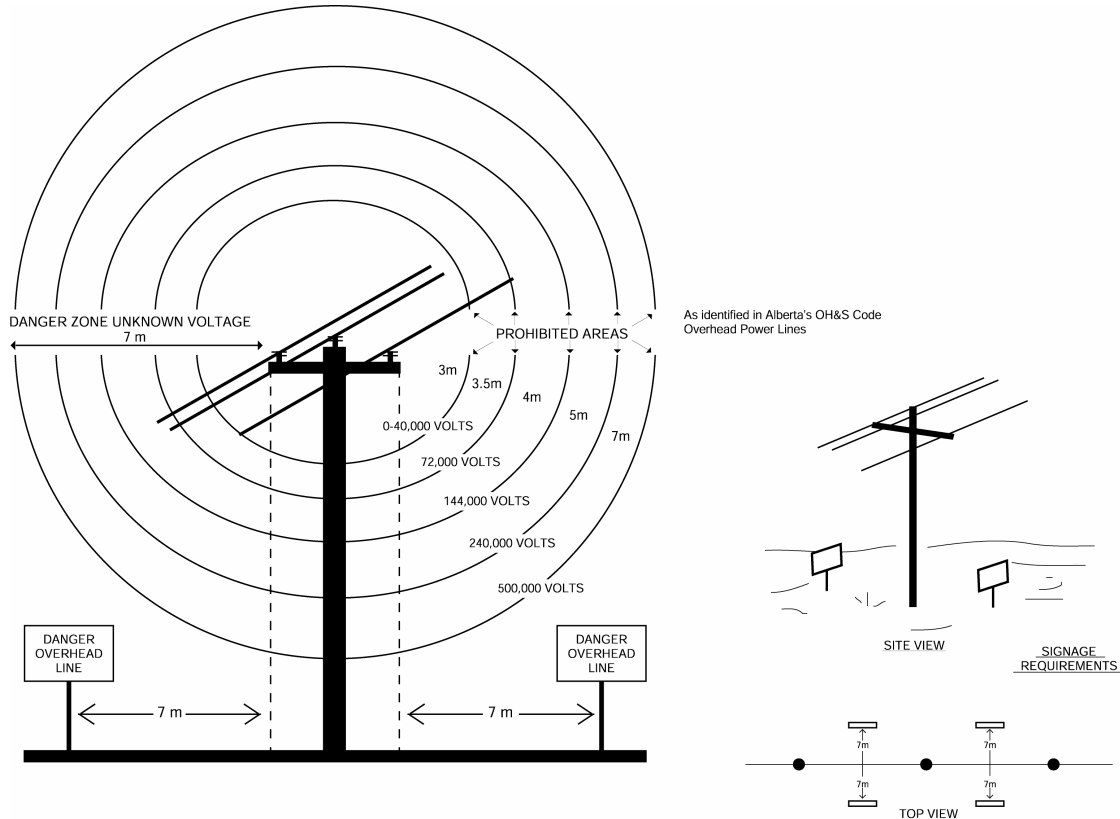

Purpose: These minimum requirements are for your protection and safety. Contact with power lines is extremely dangerous and could result in death.

- 1) **Danger Zone** (unknown voltage) Equipment must **NOT** be operated within 7 m of any overhead power line without notifying ATCO Electric.
- 2) **Prohibited Area** (voltage confirmed by ATCO Electric)
 - a) No unqualified worker or equipment can enter the Prohibited Area.
 - b) ATCO Electric recommends all work within the 7 m Danger Zone, but outside the Prohibited Area require a designated signaller who can communicate by radio or air horn with all workers and equipment.
- 3) **NEVER ALLOW WORKERS OR EQUIPMENT TO ENTER THE PROHIBITED AREA!**
If work cannot be done outside the Prohibited Area contact ATCO Electric for assistance.
- 4) Work near power lines must be done during daylight hours only.
- 5) ATCO Electric recommends installing a minimum of two 50.8 cm x 71 cm "Danger Overhead Line" signs when operating equipment near the lines. (These can be purchased through most safety supply companies.) The signs must be installed on both sides of the line — at a height of 1.8 m and a distance of 7 m from the line. (Refer to the diagrams above.)
- 6) On-site workers must have a copy of the crossing agreement and all on-site personnel must be knowledgeable of its requirements.

Any violation could lead to sanctions under the OH&S Act and Regulation

IF YOU ACCIDENTALLY CONTACT AN OVERHEAD POWER LINE

— STAY CLEAR AND CALL ATCO ELECTRIC

1-800-668-5506

ATCO Electric